

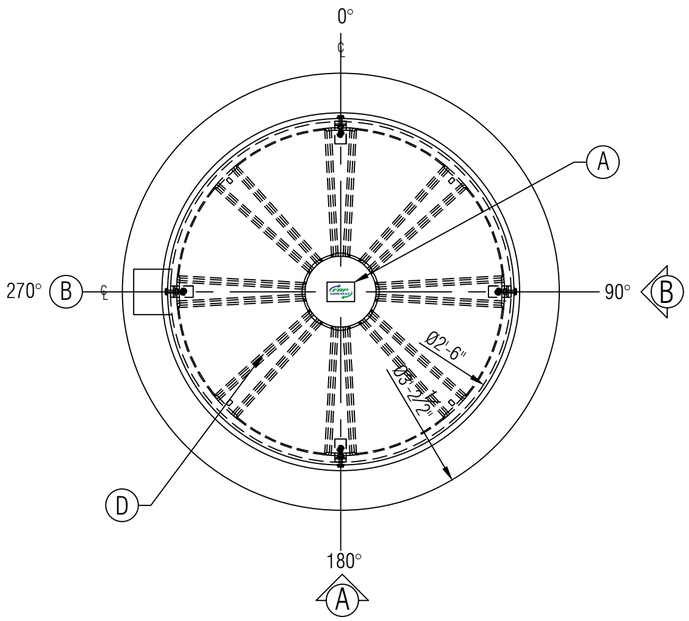



PLAN

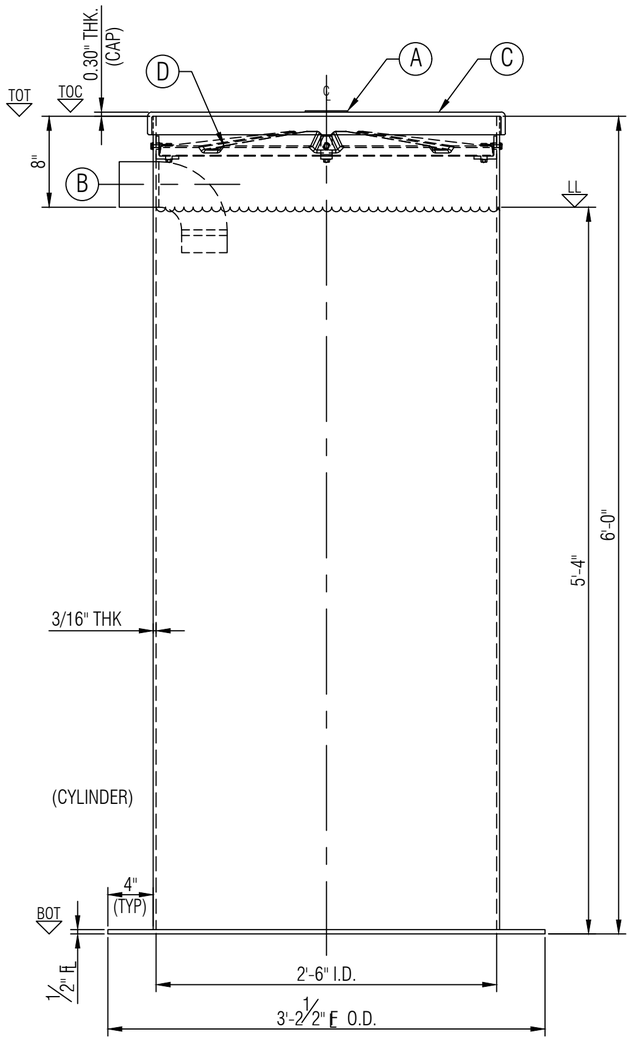

ELEVATION A

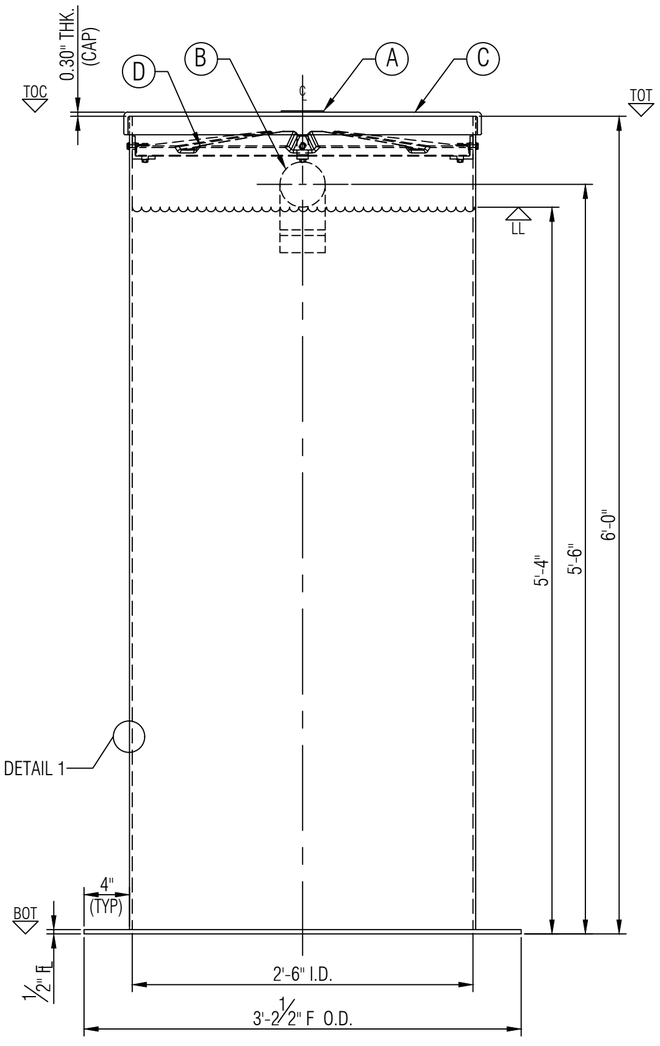

ELEVATION B

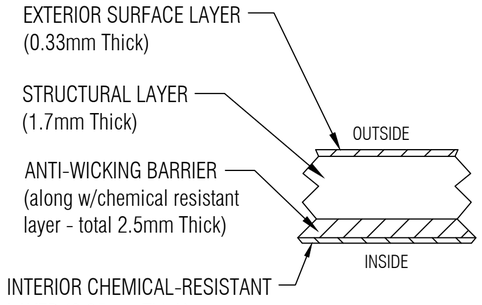

LAMINATE DETAIL 1

N T S

GENERAL NOTES:
- CSA B66 CERTIFIED FOR SEWAGE.
- TANK COMES UNASSEMBLED FROM FACTORY.
- TESTED TO 10'-0" BURIAL DEPTH.
- DIMENSIONS SHOWN IN FEET INCHES FORMAT OTHERWISE NOTED.
- 1/2" FABRICATION TOLERANCE. DOES NOT APPLY TO LAMINATE THICKNESS.

LEGEND:
TOL - TOP OF LID
TOC - TOP OF CAP
TOT - TOP OF TANK
BCD - BOLT CENTER DIAMETER
BOT - BOTTOM OF TANK
LL - LIQUID LEVEL
I/S - INSIDE
O/S - OUTSIDE
Ø - DIAMETER
° - DEGREE/S
TYP- TYPICAL
℄ - CENTER LINE
NTS - NOT TO SCALE

ITEM#	QTY	PART LIST/DESCRIPTION	APPROX. WEIGHT:	82 KG (180 LBS)	DRAWN:	ATF
A	1	NAMEPLATE	OVERALL CAPACITY:	818 L (180 IG/216 USG)	CHECKED:	
B	1	4"Ø PVC - INLET			DATE:	JAN 23, 2025
C	1	30"Ø DETACHABLE - CAP LID			DESIGNED:	
D	1	POLYETHYLENE SAFETY GRATE C/ W HARDWARE			APPROVED:	MPS
E					MFG:	DS
F					PM:	GA
G					SALES:	DG

CLIENT: FRP/MOCOAT FIBERGLASS LTD.
TITLE: **HT30D72L FRP TANK**
FRPMOCOAT FIBERGLASS LTD.
SIZE: C | DRAWING NUMBER: HT30D72L | REVISION: 0
SCALE: 1:10 | EST#: | SO#: | SHEET: 1/1
PO#: | JOB#: